

HALIBURTON, KAWARTHA, PINE RIDGE DISTRICT HEALTH UNIT

MON-25-76

FILE NUMBER

SEWAGE SYSTEM INSPECTION REPORT AND USE PERMIT

REPORT:


DATE: AUG 26/76

INSTALLED BY: JOHN JACKSON

Work authorized by certificate of approval has been satisfactorily completed and includes:

- A. Septic Tank/Holding Tank of working capacity of 600 imp. gals. constructed of steel/concrete/fiberglass on site or prefabricated to serve 2 bedrooms
- B. Leaching Bed of total 150 lineal feet of PVC distribution pipe laid in 3 runs of 50 feet (P.V.C., Drain Tile, etc.) and fed by Gravity/Syphon/Pump,
- C. Other Details 4' OF GRANULAR FILL PROVIDED.

Actual location and orientation of components of sewage system are as shown hereunder or as outlined on the Certificate of Approval form

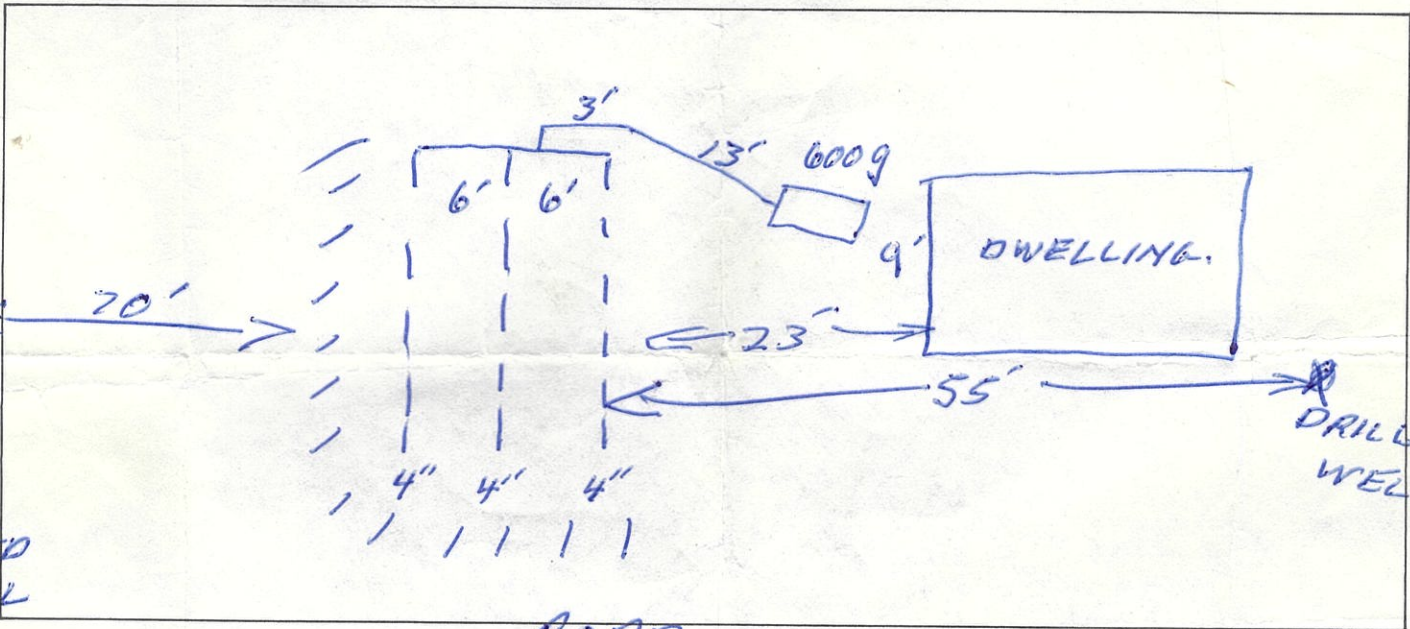

The following work remains to be completed: Backfill system and complete ; Stabilize all sloped surfaces ; Finish grading to shed run-off and divert water away from leaching bed ; Other REPLACE INLET & OUTLET BIAFFLES.

USE PERMIT

Under section 59A of the Environmental Protection Act, 1971 and regulations and subject to the limitations thereof a permit is hereby granted to

S. BEATTIE

for the use and operation of the Class 4 Sewage System Installed/Altered under Certificate of Approval # 2576 Dated AUG 11/76

in accordance with the application and Certificate of Approval with any changes indicated above and located on lot 32 Conc. 17

Township/Municipality MONMOUTH County HALIBURTON Plan No. Sub Lot No.

Inspected and Recommended by B. J. MacNeill

Dated this 26 Day of AUG 19 76 Issued B. J. MacNeill (Director)

NOTE: Section 57A of the Act provides that no change can be made to any building(s) or structures in connection with which this sewage system is used, if the operation or effectiveness of the sewage system will be affected by the change, unless a Certificate of Approval is obtained.